

## Square Gear Trays

Product Codes: **GTS13-35, GTS13E-35, GTS13/MS-35 & GTS13E/MS-35**

### Safety Warning





- The installation should be carried out by a qualified electrician in compliance with the current edition of the IEE Wiring Regulations.
- Prior to installation, carry out the necessary risk assessment considering the people who could be at risk, the level of risk and the precautions required to control the risk
- Ensure that the circuit supply is isolated either by the circuit supply fuse being removed or the applicable circuit breaker being turned off before installation or any maintenance.
- Check the total load on the circuit ensuring the luminaire does not exceed the rating of the circuit cable, fuse or circuit breaker.
- Long-term use and voltage fluctuations can reduce the life span of the fitting.
- If the fitting incorporates control gear, ensure careful sizing to avoid instances of nuisance tripping of the protective device used in the installation.
- Follow the provided installation instructions, using the fixings supplied or recommended.
- Keep out of reach of children.



### Specification

**Box Contents -**  
1 x Square Gear Tray

<b>Dimensions:</b>	L: 230 x W: 226 x D: 30mm
<b>Material:</b>	Phenolic Resin
<b>Working Temperature:</b>	Standard: -20°C - 40°C Emergency: 0°C - 40°C
<b>Included:</b>	Fast Fit Terminal Block

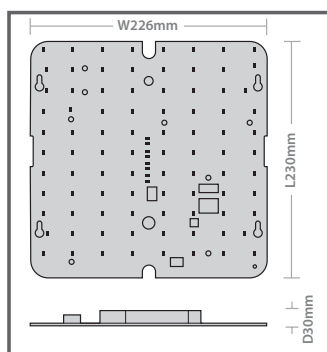

\*Batteries 1 year guarantee

### MAXIMUM FITTINGS PER CIRCUIT


Automatic Circuit Breaker Type:	B6	B10	B13	B16	B20	C10	C13	C16	C20
<b>Rated Current:</b>	6A	10A	13A	16A	20A	10A	13A	16A	20A
<b>Cable (mm):</b>	1.5	1.5	1.5	1.5	2.5	1.5	1.5	1.5	2.5
<b>GTS13-35 / GTS13/MS-35</b>	40	70	90	120	150	70	90	120	150
<b>GTS13E-35 / GTS13E/MS-35</b>	35	65	85	110	140	65	85	110	140

### Installation Instructions


**Note: This is a class II electrical product - no earth required**

1. Isolate the mains supply before commencing with the installation.
2. A. Install the Red Arrow Robust Square Body only (order separately).  
OR  
B. Prepare existing housing ready to install gear tray - checking that the retaining screw positions are compatible with those of the gear tray.
3. A. Feed the mains cable into the housing.  
B. If the housing is not already installed, hold the fitting up to the ceiling / wall in the desired position and mark hole fixing centres.  
C. Drill fixing.  
D. Insert the rawl plugs.  
E. Fix in the position.

- Ensure the gear tray has a switched live supply to "L" (switched live). Route the mains supply cable to the terminal block on the gear tray and terminate, ensuring correct polarity is observed. Ensure all conductors are fully sleeved and insulated.

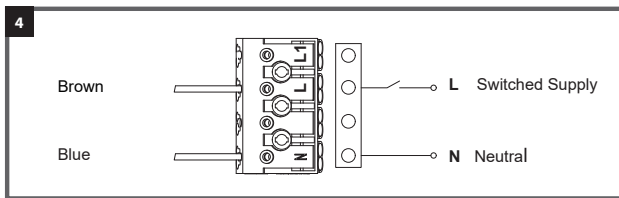

- Fit the gear tray and secure by placing onto retaining screws, slide to lock the screws into the keyhole slots & then tightening the screws.

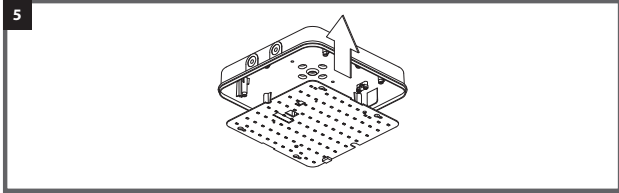


- Refit the diffuser onto the housing.

Restore the mains supply, switch on and test for satisfactory operation.

**Important:** This gear tray is designed for use with Red Arrow Robust Square Empty Bodies. When installing this gear tray into an existing housing not supplied by Red Arrow, we strongly recommend that the internal volume of the housing is no less than 4650cm<sup>3</sup> (4.65 litres), for thermal considerations.

## Emergency Version Instructions

- Follow instructions 1-3 on the previous page.
- The luminaire requires a secondary unswitched live supply as well as a switched supply. Connect the unswitched supply to the terminal marked L1. Connect the switched supply to the terminal marked L. The 'unswitched' supply must be taken from the same phase as the 'switched' supply and must be wired to the same MCB so that upon test, it is isolated at the same time as the switched supply.

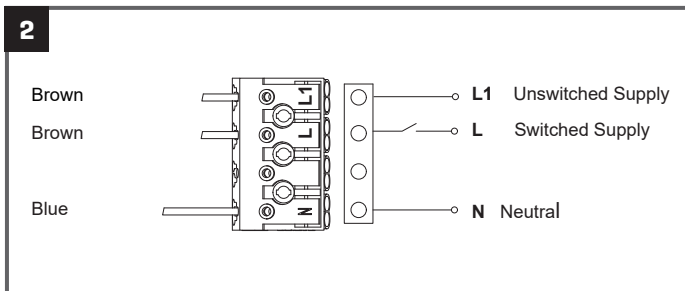

- Route the cable to the terminal block and terminate, ensuring correct polarity is observed.
- When the power supply is reconnected, check the green LED illuminates. This indicates the batteries are charging.
- The batteries should be charged for at least 24 hours before carrying out a full discharge test, to check batteries are charging correctly and 3 hour emergency duration is achieved.

**Note:** For non-maintained operation, only an unswitched supply to terminal L1 is required.


For switched maintained, follow instructions in 2 above.

For unswitched maintained operation, connect cables as in 2 above but also link L & L1.

## Instructions for Microwave Sensor Set Up

The Microwave Sensor allows the Gear Tray to detect when an occupant enters or leaves an area, turning the luminaire on or off accordingly.

- The sensor should be positioned so that the occupants of the area fall inside the detection patterns shown in the diagram below.

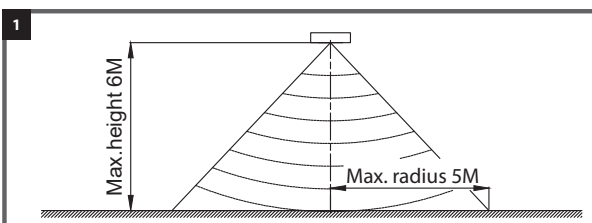

- The diagram is based on a maximum ceiling mounting height of 6m. Note that the lower the sensor is installed, the smaller the detection range will be e.g. at a ceiling height of 2.8m the detection diameter is approximately 4.7m.
- The distances quoted are approximate and may vary depending on the surroundings.
- Do not site within 1m of forced air heating or ventilation.
- Do not fix to a vibrating surface.

6. Sensitivity can be adjusted by selecting the required combination on dip switches 1 & 2 for different applications.

6

I - 1 0 0 %			1	2	
II - 7 5 %		I	ON	ON	100%
III - 5 0 %		II	ON	—	75%
IV - 1 0 %		III	—	ON	50%
		IV	—	—	10%

7. Hold time refers to the time period that the light remains on if no more movement is detected. Set using dip switches 3 & 4.

7

I - 5 s			3	4	
II - 9 0 s		I	ON	ON	5s
III - 5 m i n		II	ON	—	90s
IV - 1 5 m i n		III	—	ON	5min
		IV	—	—	15min

8. Different daylight thresholds can be pre-set using dip switches 5 & 6. Light will always turn on upon movement if daylight sensor is disabled.

8


I - D i s a b l e			5	6	
II - 5 0 L u x		I	ON	ON	Disable
III - 1 0 L u x		II	ON	—	50Lux
IV - 2 L u x		III	—	ON	10Lux
		IV	—	—	2Lux

## Guarantee

This product is guaranteed for a period of 5\* years from the date of purchase (\*batteries 1 year). The guarantee is invalid in the case of improper use, tampering, removal of the Q.C. date label, installation in an improper working environment or installation not according to the current edition of the I.E.E. Wiring Regulations (BS7671). The guarantee is also invalidated if the luminaire has been insulation tested. Should this product fail during the guarantee period it will be replaced free of charge, subject to correct installation and return of the faulty unit. We do not accept responsibility for any installation costs associated with the replacement of this product. Your statutory rights are not affected. We reserve the right to alter specifications without prior notice.

## Maintenance

- This fitting will require routine cleaning if used in adverse (dust, paint, welding, oils etc) environments. Do not use solvents, aggressive detergents or abrasives.
- The driver can be quickly and easily replaced at end of life. This should be carried out by a competent person. Contact Red Arrow for details of replacements. The LEDs in this light source cannot be replaced

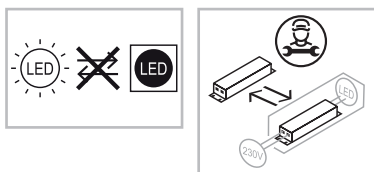

- When this fitting comes to the end of its life or you choose to replace it, please do not dispose of it with your normal waste. Please recycle where the facilities exist, check with your local authority for suitable options.

INS/COMMERCIAL/0009/GTS13\_V6